


Protecting Our Water Environment

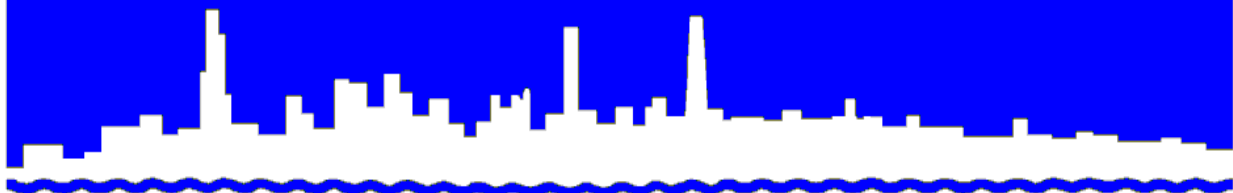

Metropolitan Water Reclamation District of Greater Chicago

***MONITORING AND RESEARCH
DEPARTMENT***

REPORT NO. 21-20

THORNTON COMPOSITE RESERVOIR

GROUNDWATER MONITORING REPORT

FIRST QUARTER 2021

May 2021

Protecting Our Water Environment



Metropolitan Water Reclamation District of Greater Chicago

CECIL LUE-HING RESEARCH AND DEVELOPMENT COMPLEX
6001 WEST PERSHING ROAD CICERO, ILLINOIS 60804-4112

Edward W. Podczerwinski, P.E.
Director of Monitoring and Research

BOARD OF COMMISSIONERS

Kari K. Steele
President
Barbara J. McGowan
Vice President
Marcelino Garcia
Chairman of Finance
Cameron Davis
Kimberly Du Buclet
Josina Morita
Eira L. Corral Sepúlveda
Debra Shore
Mariyana T. Spyropoulos

May 13, 2021

Mr. Michael Summers
Groundwater Section Manager
Bureau of Water/Public Water Supplies
Illinois Environmental Protection Agency
1021 North Grand Avenue East
Springfield, IL 62794
MICHAEL.SUMMERS@Illinois.gov

Dear Mr. Summers:

Subject: Transmittal of the Report “Thornton Composite Reservoir Groundwater Monitoring Report First Quarter 2021”

Please find attached the report entitled “Thornton Composite Reservoir Groundwater Monitoring Report First Quarter 2021” transmitted electronically. The report is prepared for transmittal to the Illinois Environmental Protection Agency (IEPA) in accordance with the Thornton Composite Reservoir Groundwater Monitoring Plan. Also attached is the Excel spreadsheet of the Thornton Composite Reservoir raw data as required by the IEPA.

If you have any questions or would like to have additional information, please contact Mr. Benjamin Morgan at (708) 588-3743 or MorganB@mwrdd.org.

Very truly yours,

Albert E. Cox, Ph.D.
Environmental Monitoring and Research Manager
Monitoring and Research Department

AC:BM:cm
Attachment
cc: Mr. M. Brown, IEPA
Mr. E. Podczerwinski

Metropolitan Water Reclamation District of Greater Chicago
100 East Erie Street Chicago, Illinois 60611-2803 (312) 751-5600

Thornton Composite Reservoir Groundwater Monitoring Report
First Quarter 2021

Benjamin Morgan
Environmental Soil Scientist

Guanglong Tian
Principal Environmental Scientist

Albert Cox
Environmental Monitoring and Research Manager

Heng Zhang
Assistant Director of Monitoring and Research
Environmental Monitoring and Research Division

TABLE OF CONTENTS

	<u>Page</u>
LIST OF TABLES	ii
LIST OF FIGURES	iii
LIST OF ACRONYMS	iv
ACKNOWLEDGMENT AND DISCLAIMER	v
INTRODUCTION	1
FIELD ACTIVITIES	5
ANALYTICAL RESULTS	8
REFERENCES	11

LIST OF TABLES

<u>Table No.</u>		<u>Page</u>
1	Characteristics of Monitoring Wells TB-118 Through TB-124 at the Thornton Composite Reservoir Site	3
2	Devices and Corresponding Dates of Sampling During Fill Event Sampling in March 2021	6
3	Summary of Groundwater Elevations at Sampling Port 3 of Each Well and Corresponding Groundwater Elevations During Fill Event Sampling in March 2021	7
4	Analytical Methods Used for Required Parameters	9
5	Analysis of Groundwater Sampled From Monitoring Wells TB-118 Through TB-124 and the Main Quarry Sump at the Thornton Composite Reservoir Site for Fill Event Sampling in March 2021	10

LIST OF FIGURES

<u>Figure No.</u>		<u>Page</u>
1	Monitoring Well and Main Quarry Sump Locations	2

LIST OF ACRONYMS

Acronym	Definition
CCD	Chicago City Datum
CFU	Colony Forming Unit
CSF	Combined Sewer Flow
GMP	Groundwater Monitoring Plan
GPS	Groundwater Protection System
IAC	Illinois Administrative Code
TCR	Thornton Composite Reservoir
TOC	Total Organic Carbon

ACKNOWLEDGMENT

This report for the Thornton Composite Reservoir Groundwater Monitoring was generated by the Monitoring and Research Department. All samples were collected by A3 Environmental Consultants (contractor) under the Thornton Composite Reservoir Contract 21-100-11. Analyses were performed by the Analytical Laboratories Division and the Analytical Microbiology Section of the Metropolitan Water Reclamation District of Greater Chicago. Special thanks are due to Ms. Coleen Maurovich for typing and formatting this report.

DISCLAIMER

Mention of proprietary equipment and chemicals in this report does not constitute endorsement by the Metropolitan Water Reclamation District of Greater Chicago.

INTRODUCTION

A Groundwater Protection System (GPS) was constructed for the Thornton Composite Reservoir (TCR) to protect against the exfiltration of combined sewer flow (CSF) into the surrounding dolomite aquifers. The CSF and minimal amounts of stormwater are stored in the reservoir during and after large storm events. To monitor the performance of the GPS, a network of monitoring wells located outside the perimeter of the GPS is being monitored as discussed in the Revised Groundwater Monitoring Plan (GMP) (Black & Veatch, 2016). As explained in the Revised GMP, one sample of reservoir water, one of the Main Quarry Sump, and one from each of the seven wells are collected annually and analyzed for the Illinois Administrative Code (IAC) Title 35 Part 620 Class I groundwater constituents. In addition, following a reservoir fill event or during a routine quarterly event, groundwater is sampled from the seven wells and the Main Quarry Sump and tested for a targeted list of parameters that are more likely to be detected in CSF water.

The monitoring well system consists of one deep well, TB-124, which monitors the underlying Galena Aquifer, and six vertical Westbay multi-level monitoring wells: TB-118, TB-119, TB-120, TB-121, TB-122, and TB-123, which monitor the Silurian Dolomite aquifers. As discussed in the Revised GMP, following a reservoir fill event, bi-weekly sampling is required while the water in the reservoir remains above an elevation of -280 ft Chicago City Datum (CCD). Groundwater is sampled from each well at the first sample interval port immediately below the reservoir water elevation. Each of the multi-level monitoring wells is capable of monitoring four distinct 20-ft intervals in the Silurian Dolomite aquifer.

The locations of monitoring wells, quarry sump, TCR, and the GPS are presented in Figure 1. The Main Quarry Sump is located beyond the south boundary of the GPS and is not a component of the TCR but is an integral part of the Hanson Material Services mining quarry to the south of the TCR. This sump facilitates mining operations by minimizing the water level at the bottom of the quarry. It is possible that the bottom of this sump could extend beyond the lowest depth of the TCR (-297.5 CCD ft). The sump contains mainly groundwater and small quantities of surface runoff, and it is sampled quarterly and during fill events, along with the wells, to evaluate the potential migration of contaminants from the TCR to the sump.

Table 1 lists the characteristics of all wells at the TCR site (well location coordinates, elevations and depths, and the sampling port interval elevations).

Prior to the TCR becoming operational in November 2015, eight (8) sampling events were conducted on a quarterly basis for two years (May 2012 through March 2014) to provide background data on the existing groundwater quality. In order to evaluate the effectiveness of the grout curtain and the GPS, the Revised GMP (2016) presents the analysis of data for all samples collected during the background monitoring period and provides a baseline for comparison with routine monitoring data. Changes over time in groundwater calcium and magnesium concentrations would also be useful in tracking the occurrence of infiltration/exfiltration. Groundwater analytical data routinely generated for the monitoring wells, reservoir, and sump

FIGURE 1: MONITORING WELL AND MAIN QUARRY SUMP LOCATIONS

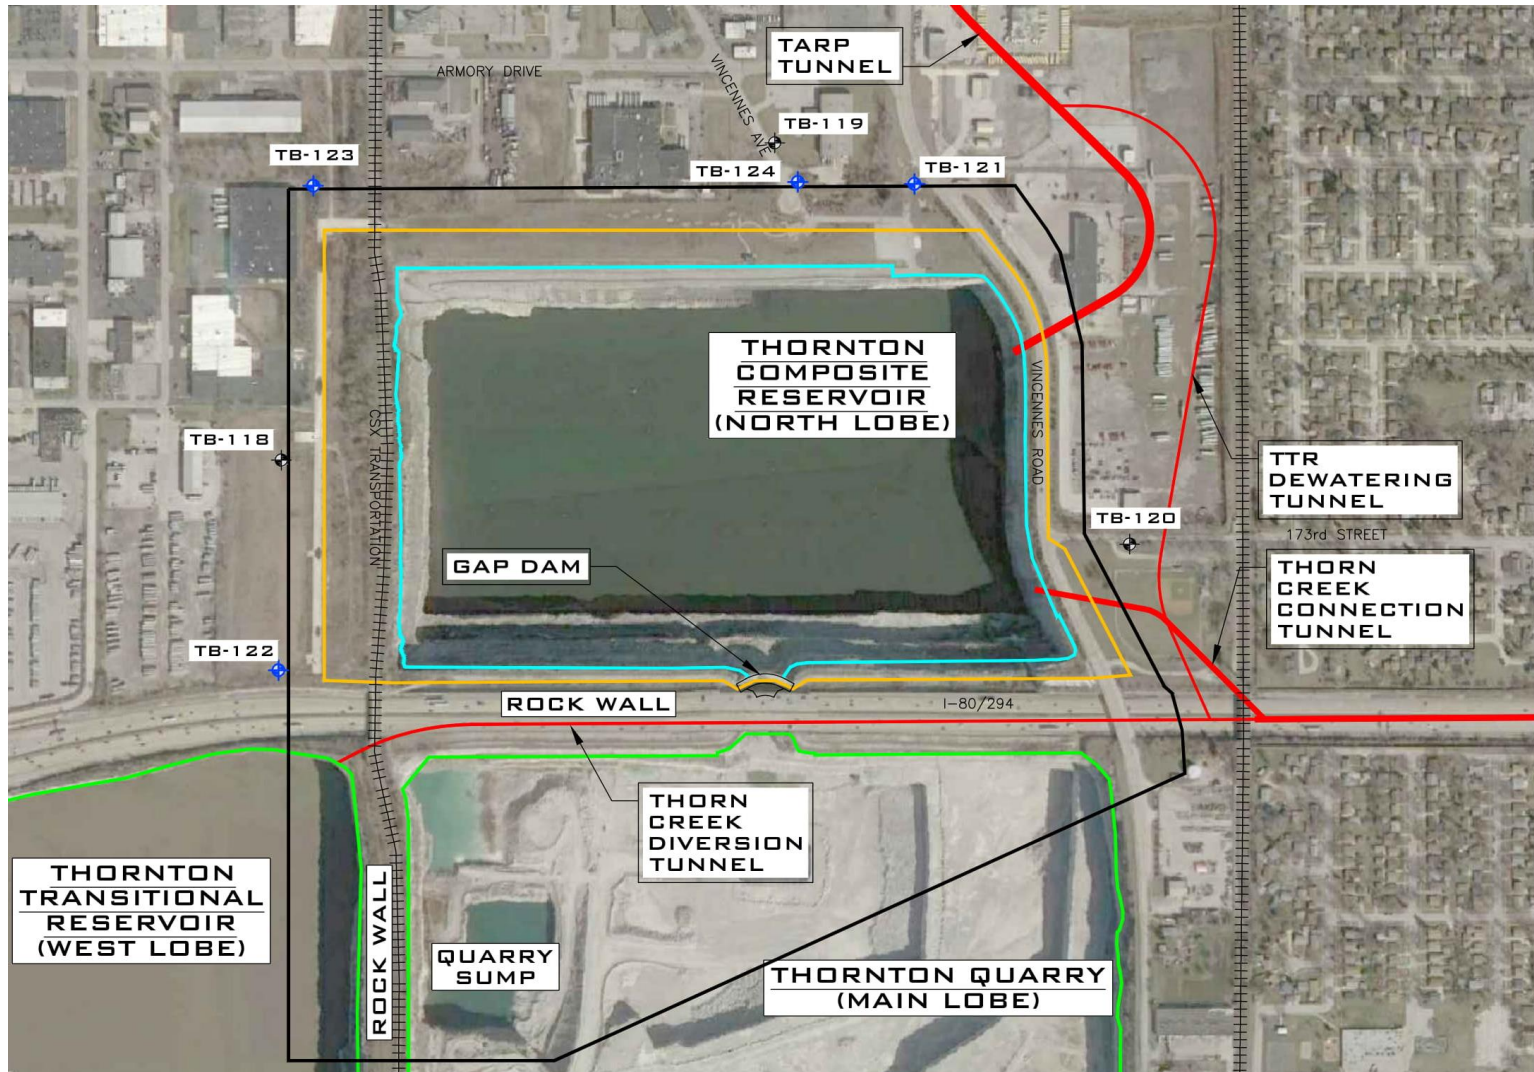


TABLE 1: CHARACTERISTICS OF MONITORING WELLS TB-118 THROUGH TB-124
AT THE THORNTON COMPOSITE RESERVOIR SITE

Well ID	Coordinates ¹		Ground Surface Elevation (ft, CCD ²)	Top of Riser Elevation (ft, CCD ²)	Depth of Well (ft)	Sampling Port Interval (ft, CCD)			
	Northing (ft)	Easting (ft)				Interval 1	Interval 2	Interval 3	Interval 4
TB-118	1,791,110.38	693,560.44	38.5	41.5	532	-85 to -105	-212 to -232	-283 to -303	-392 to -412
TB-119	1,792,316.63	695,509.39	27.9	29.5	529	-85 to -105	-212 to -232	-283 to -303	-392 to -412
TB-120	1,790,782.31	696,888.93	40.0	42.1	540	-86 to -106	-213 to -233	-284 to -304	-393 to -413
TB-121	1,792,193.10	696,044.98	29.4	30.4	461	-84 to -104	-211 to -231	-282 to -302	-391 to -411
TB-122	1,790,288.61	693,549.38	48.8	51.7	480	-85 to -105	-212 to -232	-283 to -303	-392 to -412
TB-123	1,792,185.60	693,685.69	28.9	31.8	460	-84 to -104	-211 to -231	-282 to -302	-391 to -411
TB-124	1,792,200.77	695,591.56	29.6	29.2	728	-663 to -698			

¹Illinois State Plane Coordinate System (NAD 1927).

²Chicago City Datum (CCD).

will also be compared with the IAC Title 35 Part 620 Class I Groundwater Standards (PCB, IEPA, 2013) to evaluate any exceedances in groundwater standards.

There was one fill event during the first quarter of 2021. This was the first fill event of 2021. The fill event began on February 28 and lasted until March 7, requiring a single sampling conducted from March 4 – 8. One complete set of samples was collected at the Main Quarry Sump and all monitoring wells.

This report presents field activities, observations, and analytical data for surface and groundwater monitoring samples taken at the Main Quarry Sump and at all monitoring wells during fill event sampling conducted from March 4 – 8, 2021.

FIELD ACTIVITIES

For this report period, one complete set of samples was collected at the Main Quarry Sump, the deep well, and at sampling port interval 3 of all multi-level wells during fill event sampling from March 4 – 8, 2021 (Table 2).

Using a WTW Multi 3400i pH/conductivity/temperature meter, the pH, electrical conductivity (EC), and temperature of each sample were measured and recorded immediately after collection.

Prior to sampling the multi-level wells, hydrostatic pressure was measured to calculate the groundwater elevation at Port 3 of each well. Table 3 lists the elevations at Port 3 of each well and the corresponding groundwater elevations during fill event sampling from March 4 – 8, 2021.

All samples were packed in ice and transported to the Metropolitan Water Reclamation District of Greater Chicago's (District) Analytical Laboratories Division for the analysis of selected inorganic constituents (IAC Title 35 Part 620 Class I Groundwater Standards) in accordance with the revised GMP. Additional aliquots were also prepared in the field and transported in ice to the District's Analytical Microbiology Laboratory for fecal coliform analysis.

TABLE 2: DEVICES AND CORRESPONDING DATES OF SAMPLING DURING FILL
EVENT SAMPLING IN MARCH 2021

Date of Sampling	Event	Device/Structure Sampled
03/04/2021	Fill event #1	Sump, Sump Duplicate
03/05/2021	Fill event #1	TB-119, TB-120, TB-121
03/08/2021	Fill event #1	TB-118, TB-122, TB-123, TB-124

TABLE 3: SUMMARY OF GROUNDWATER ELEVATIONS AT SAMPLING PORT 3 OF EACH WELL AND CORRESPONDING GROUNDWATER ELEVATIONS DURING FILL EVENT SAMPLING IN MARCH 2021

Sample Date	Well ID	Sampling Port 003 Elevation	Groundwater Elevation
		----- (ft CCD ¹) -----	
03/08/2021	TB-118	-289	-87
03/05/2021	TB-119	-289	-164
03/05/2021	TB-120	-290	ND ²
03/05/2021	TB-121	-288	-170
03/08/2021	TB-122	-288	-161
03/08/2021	TB-123	-288	-51
03/08/2021	TB-124 ³	NA ⁴	-342

¹Chicago City Datum.

²No data available. Pressure readings could not be made at ports in this well.

³TB-124 is a conventional well screened from -663 to -698 ft CCD. During March, one sample was taken at approximately 650 ft below ground surface.

⁴NA = Not Applicable.

ANALYTICAL RESULTS

Table 4 lists the analytical methods used by the laboratory for various parameters. Analytical results were reviewed to identify any analytes that exceeded the Illinois Class I Groundwater Standards (35 IAC Part 620).

The analytical data for all well samples and the Main Quarry Sump sample collected during fill event sampling from March 4 – 8, 2021, are presented in Table 5. There were a few exceedances of the Part 620 groundwater standards, including pH, TDS, chloride, sulfate, and boron, as indicated in bold font in Table 5. Among these parameters, only pH showed a value higher than the background maximum.

Fecal coliform populations were not detected in any sample from fill event sampling in March 2021 (Table 5).

TABLE 4: ANALYTICAL METHODS USED FOR REQUIRED PARAMETERS

Analytical Parameters	Analytical Method
Chloride, Sulfate	EPA 300.0 Rev 2.1
Total Dissolved Solids	SM 2540-C
Metals except Calcium, Magnesium	EPA 200.8
Calcium, Magnesium	EPA 200.7
Ammonia (as N)	EPA 350.1
TOC	SM 5310-C
Phenols	EPA 420.4
Fecal Coliform	SM 9222D

TABLE 5: ANALYSIS OF GROUNDWATER SAMPLED FROM MONITORING WELLS TB-118 THROUGH TB-124 AND THE MAIN QUARRY SUMP AT THE THORNTON COMPOSITE RESERVOIR SITE FOR FILL EVENT SAMPLING IN MARCH 2021

Parameter	Unit	Part 620 Groundwater Standard	Maximum Background	Lab RL ¹	Well								Sump	Sump-D ²
					TB-118	TB-119	TB-120	TB-121	TB-122	TB-123	TB-124			
pH		6.5 - 9.0	8.4	NL ³	7.2	8.2	8.1	8.0	9.2	7.7	12.2	8.4	8.4	
EC	mS/m	NL	415	NL	217	136	121	152	160	107	222	115	115	
TDS	mg/L	1,200	2,960	25	1,284	530	338	1,058	800	584	1,110	1,308	1,418	
TOC	"	NL	1	1	5.1	<5.0	NDR ⁴	NDR ⁴	<5.0	<5.0	13	<5.0	<5.0	
Chloride	"	200	1,230	1	433	70	53	317	256	65	192	203	203	
Sulfate	"	400	890	1	213	109	44	200	98	134	364	553	555	
Ammonia as N	"	NL	ND ⁵	0.30	0.63	0.65	0.62	0.75	0.63	0.78	1.81	<0.30	<0.30	
Total Phenol	"	0.1	0.06	0.005	<0.005	<0.005	<0.005	<0.005	<0.005	<0.005	0.02	<0.005	<0.005	
Fecal Coliform	CFU/100 mL	NL	<1	1	<1	<1	<1	<1	<1	<1	<1	<1	<1	
10 Ag	mg/L	0.05	0.003	0.002	<0.004	<0.004	<0.004	<0.004	<0.004	<0.004	<0.004	<0.004	<0.004	
B	"	2	3.8	0.005	0.771	0.867	0.158	0.920	2.40	1.55	0.512	0.386	0.374	
Be	"	0.004	0.002	0.001	<0.002	<0.002	<0.002	<0.002	<0.002	<0.002	<0.002	<0.002	<0.002	
Co	"	1	0.035	0.001	<0.002	<0.002	<0.002	<0.002	<0.002	<0.002	<0.002	0.012	0.013	
Cr	"	0.1	86.4	0.002	<0.004	<0.004	0.017	0.024	0.005	<0.004	<0.004	<0.004	<0.004	
Cu	"	0.65	0.004	0.001	<0.002	<0.002	<0.002	<0.002	<0.002	<0.002	<0.002	<0.002	<0.002	
Mn	"	0.15	0.183	0.005	0.006	0.005	0.052	0.017	0.004	0.003	<0.002	<0.002	0.002	
Se	"	0.05	0.008	0.002	<0.004	<0.004	<0.004	<0.004	<0.004	<0.004	0.004	<0.004	<0.004	
V	"	0.049	ND	0.001	<0.002	<0.002	<0.002	<0.002	<0.002	<0.002	<0.002	<0.002	<0.002	
Zn	"	5	10	0.005	0.028	0.016	4.86	4.79	0.025	0.026	1.39	<0.010	<0.010	
Ca	"	NL	276	0.5	174	88.2	58.3	145	75.0	80.3	49.2	138	138	
Mg	"	NL	153	0.5	84.0	45.4	18.4	71.3	37.3	41.8	<0.50	114	115	

¹Lab reporting limit.

²Duplicate sample.

³No existing limit.

⁴No data reportable. Analysis was canceled due to instrument malfunction.

⁵Not determined.

REFERENCES

Black & Veatch, 2014, “Background Groundwater Quality Report for Thornton Composite Reservoir,” prepared for the Metropolitan Water Reclamation District of Greater Chicago, July 2014.

Black & Veatch, 2016c, “Revised Groundwater Monitoring Plan, Groundwater Protection System for Thornton Composite Reservoir,” prepared for the Metropolitan Water Reclamation District of Greater Chicago, May 2016.

Illinois EPA, 2012, 35 Illinois Administrative Code (IAC) Part 620 Class I Groundwater Standards, 2012.

Illinois Pollution Control Board, 2013, Illinois Administrative Code Title 35: Environmental Protection, Subtitle F: Potable Water Supplies, Chapter I: Pollution Control Board, Part 620 – Groundwater Quality, October 7, 2013.