


*Protecting Our Water Environment*

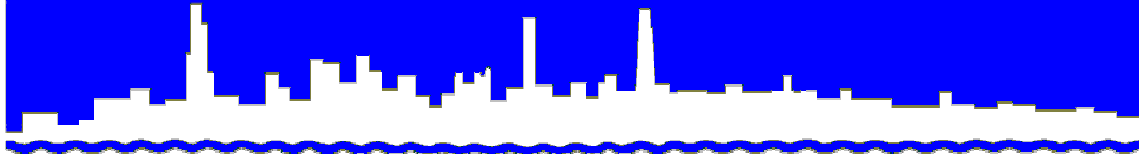

***Metropolitan Water Reclamation District of Greater Chicago***

***RESEARCH AND DEVELOPMENT  
DEPARTMENT***

***REPORT NO. 06-40***

***MONTHLY CONTROLLED SOLIDS***

***DISTRIBUTION REPORT***

***MAY 2006***

***JULY 2006***

**Metropolitan Water Reclamation District of Greater Chicago**

100 EAST ERIE STREET CHICAGO, ILLINOIS 60611-3154 312-751-5600

Louis Kollias, P.E., BCEE  
*Director of Research and Development*

July 24, 2006

312-751-5190

Mr. S. Alan Keller, P.E  
Manager, Permit Section  
Illinois Environmental  
Protection Agency  
1021 North Grand Avenue East  
P.O. Box 19276  
Springfield, IL 62794-9276

Dear Mr. Keller:

Subject: Metropolitan Water Reclamation District of Greater Chicago – Controlled Solids Distribution Program IEPA Permit No. 2005-SC-3793, May 2006

This letter transmits information and data for the Metropolitan Water Reclamation District of Greater Chicago (District) - Controlled Solids Distribution Program for May 2006, as required by Illinois Environmental Protection Agency Permit No. 2005-SC-3793.

Flow schematic diagrams for solids processed during May 2006 are shown in [Figure 1](#) - John E. Egan Water Reclamation Plant (WRP), [Figure 2](#) - Calumet WRP, and [Figure 3](#) - Stickney WRP.

No biosolids were distributed to any site in May 2006.

Very truly yours,

Louis Kollias  
Director  
Research and Development

LK:KK:spy

Attachments

cc w/att.: Aistars (USEPA)  
Sulski (IEPA)


cc via MWRDGC web site:

Sobanski  
Levy/Quintanilla  
Sharma /Conway  
Staudacher/Collins  
Granato/O'Connor  
Cox/Kumar/Dennison

# J.E. EGAN WRP SOLIDS DISTRIBUTION-

FIGURE 1


May-06

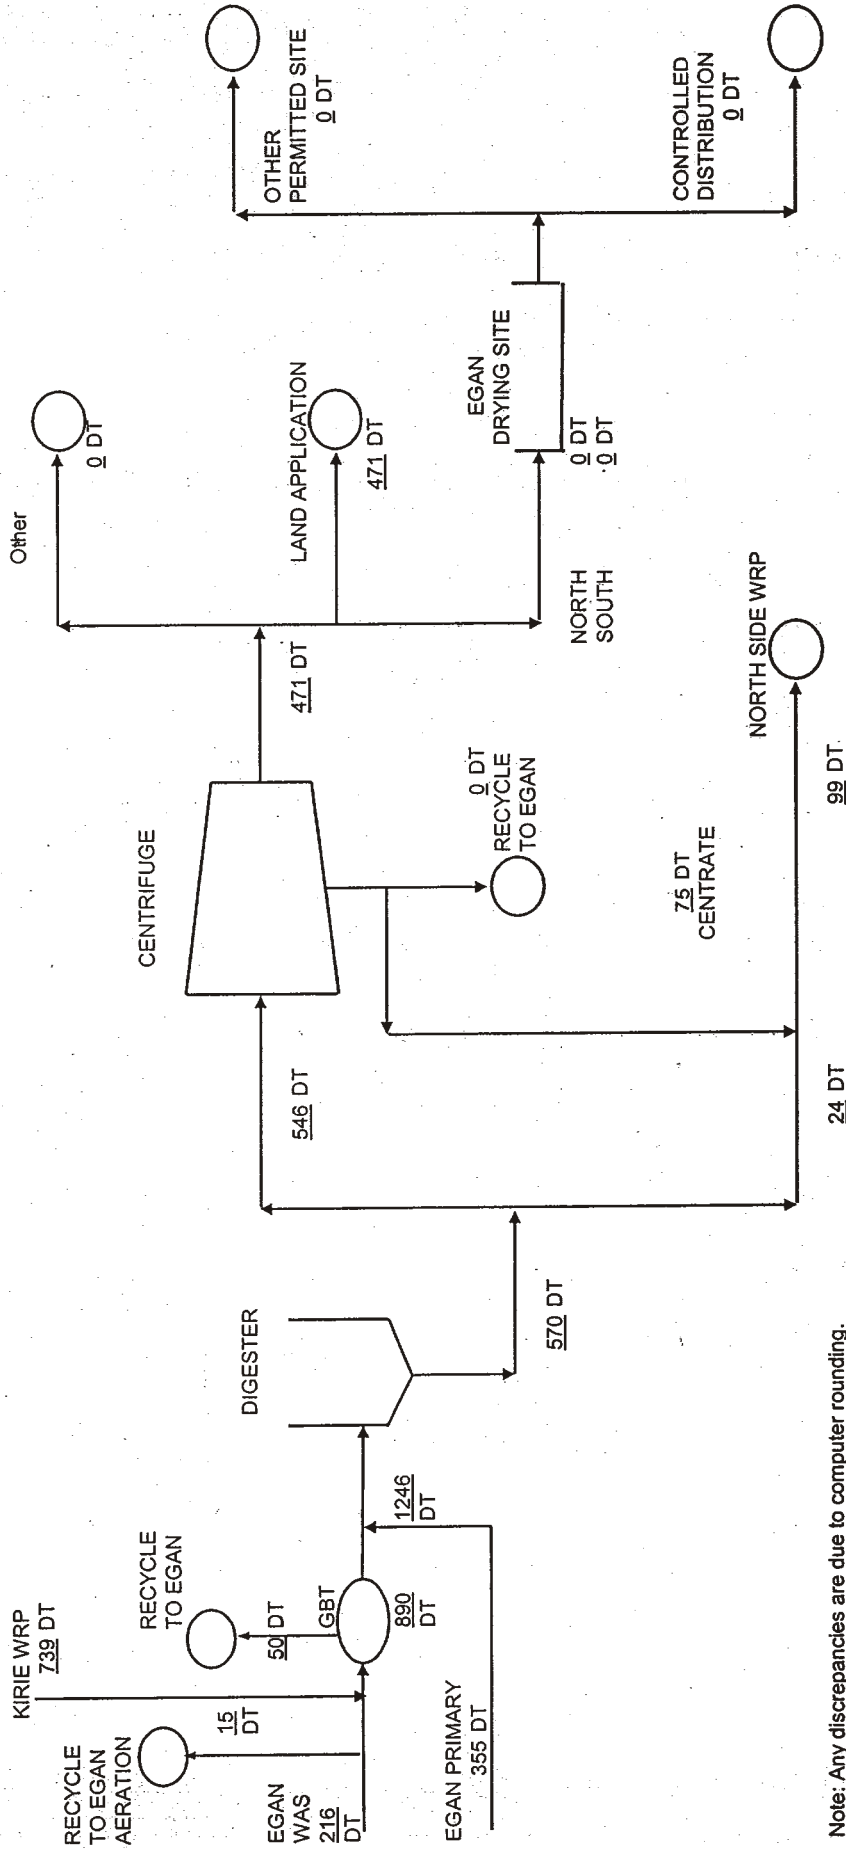

Note: Any discrepancies are due to computer rounding.


CALUMET WRP SOLIDS DISTRIBUTION - May 2006

Figure 2

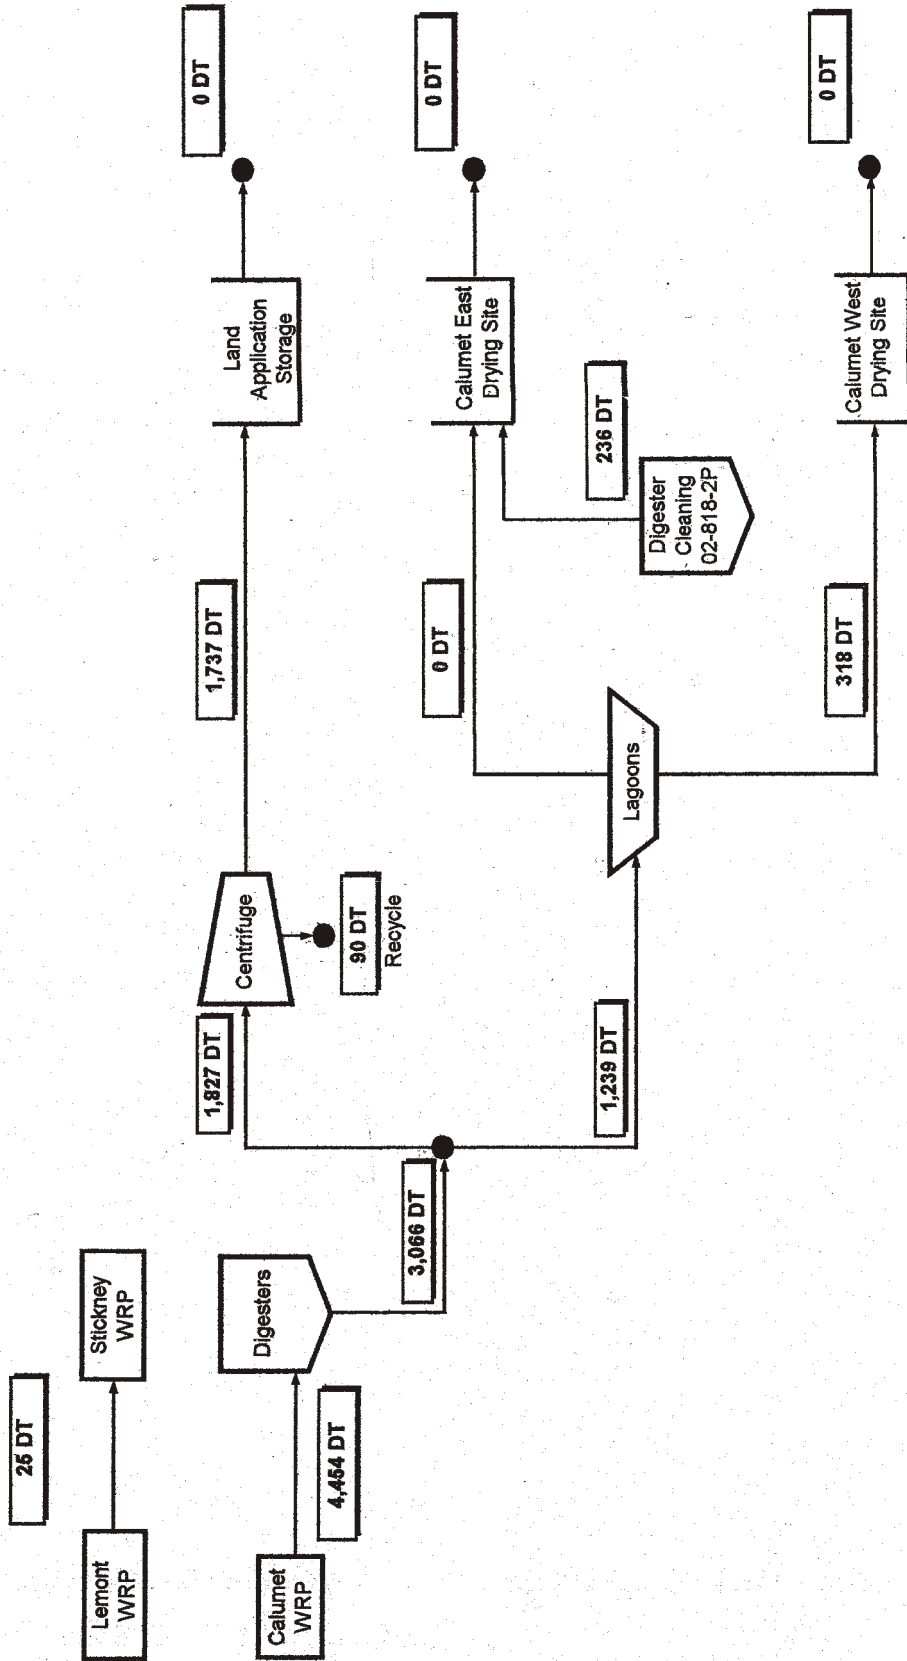

# STICKNEY WATER RECLAMATION PLANT SOLIDS DISTRIBUTION FOR MAY 2006

Figure 3

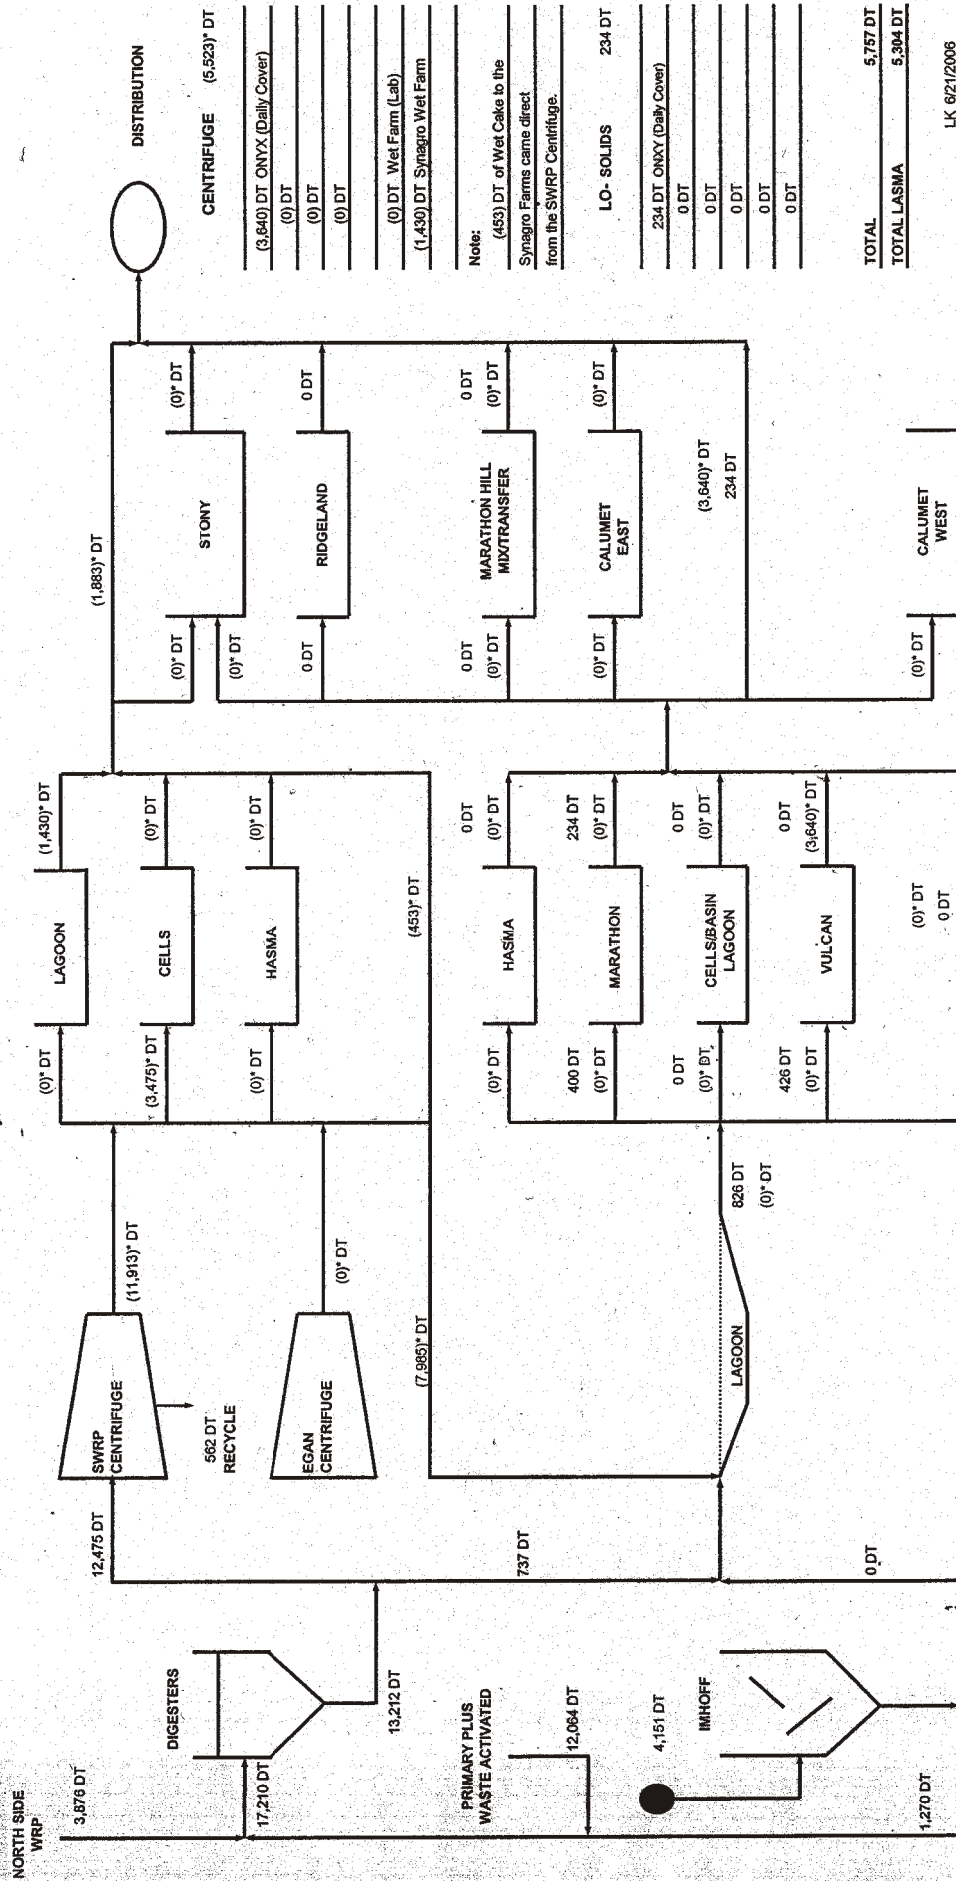

CENTRIFUGE (5,523)* DT	
(3,640) DT ONYX (Daily Cover)	
(0) DT	
(0) DT	
(0) DT	
(0) DT Wet Farm (Lab)	
(1,430) DT Synagro Wet Farm	
Note:	
(453) DT of Wet Cake to the Synagro Farms came direct from the SWRP Centrifuge.	
LO- SOLIDS	234 DT
234 DT ONYX (Daily Cover)	
0 DT	
0 DT	
0 DT	
0 DT	
0 DT	
TOTAL	5,757 DT
TOTAL LASMA	5,304 DT
LK 6/21/2006	