


Protecting Our Water Environment

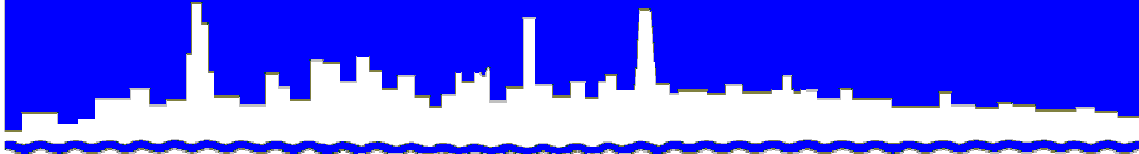

Metropolitan Water Reclamation District of Greater Chicago

***MONITORING AND RESEARCH
DEPARTMENT***

REPORT NO. 09-39

MONTHLY CONTROLLED SOLIDS

DISTRIBUTION REPORT

APRIL 2009

JULY 2009

Metropolitan Water Reclamation District of Greater Chicago

100 EAST ERIE STREET CHICAGO, ILLINOIS 60611-3154 312.751.5190

Louis Kollias, P.E., BCEE
Director of Monitoring and Research
louis.kollias@mwr.org

July 1, 2009

Mr. S. Alan Keller, P.E.
Manager, Permit Section
Illinois Environmental
Protection Agency
1021 North Grand Avenue East
P.O. Box 19276
Springfield, IL 62794-9276

Dear Mr. Keller:

Subject: Metropolitan Water Reclamation District of Greater Chicago – Controlled Solids Distribution Program, Illinois Environmental Protection Agency Permit No. 2005-SC-3793, April 2009

This letter transmits information and data for the Metropolitan Water Reclamation District of Greater Chicago - Controlled Solids Distribution Program for April 2009, as required by Illinois Environmental Protection Agency Permit No. 2005-SC-3793.

Sludge flow schematic diagrams for solids processed during April 2009 are shown in Figure 1 - John E. Egan Water Reclamation Plant (WRP), Figure 2 - Calumet WRP, and Figure 3 - Stickney WRP.

No biosolids were distributed to any site in April 2009.

Very truly yours,


Louis Kollias
Director
Monitoring and Research

LK:KK:kq
Attachments
cc: Aistars (USEPA)
Sulski (IEPA)
Sobanski
Granato/O'Connor/Cox

J.E. EGAN WRP SOLIDS DISTRIBUTION-

April-09

FIGURE 1

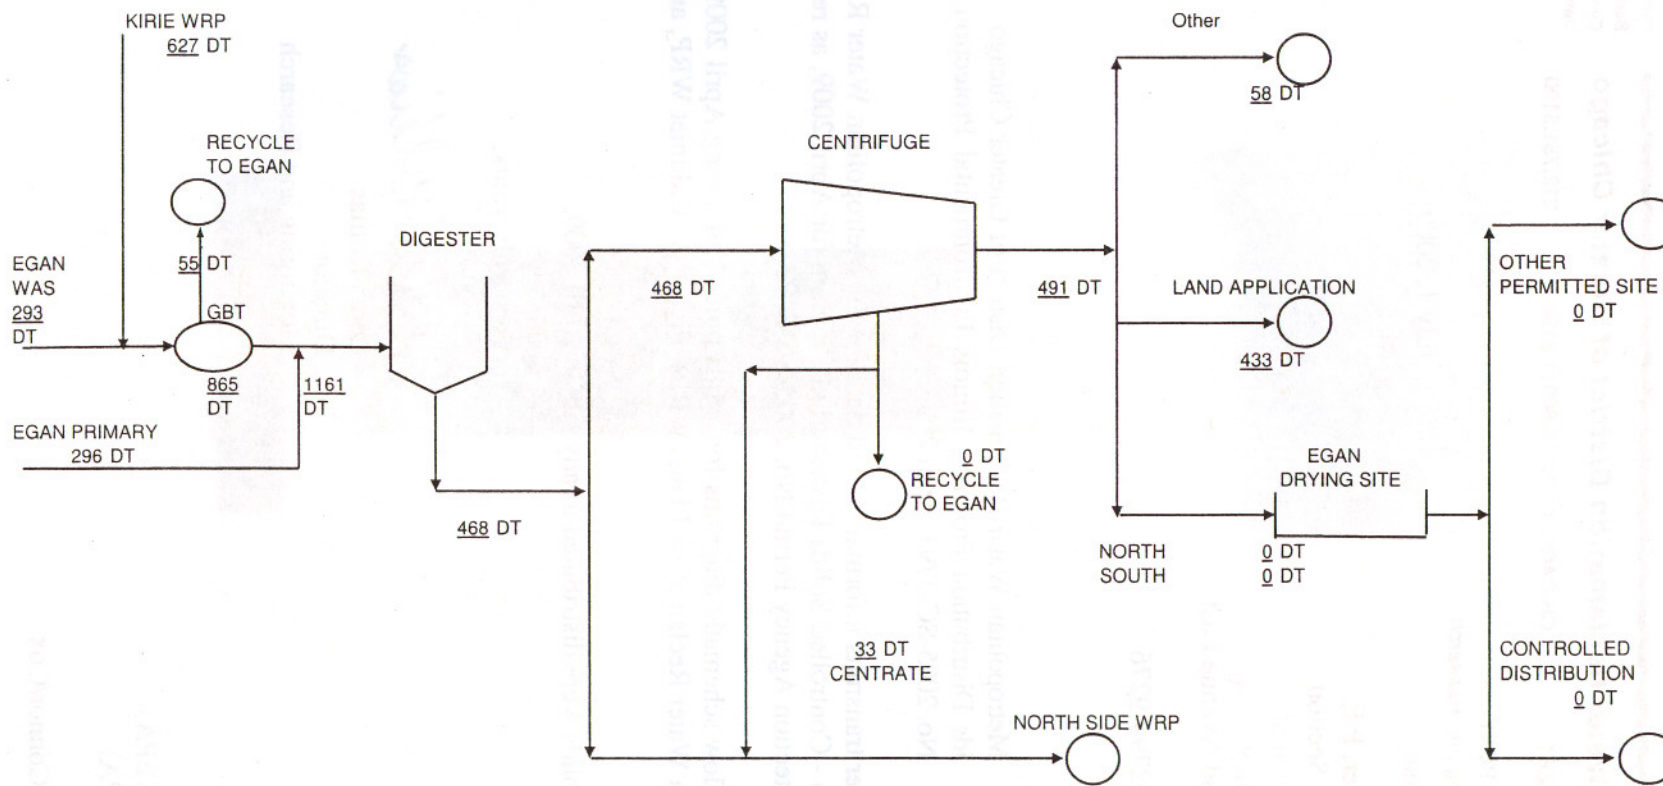

Note: Any discrepancies are due to computer rounding.
 Centrifuge draw DT exceeds Centrifuge feed DT by 23 DT because of sample anomalies. Centrate DT are estimated to be approximately 33 DT.

CALUMET WRP SOLIDS DISTRIBUTION - April 2009

Figure 2

