


Protecting Our Water Environment

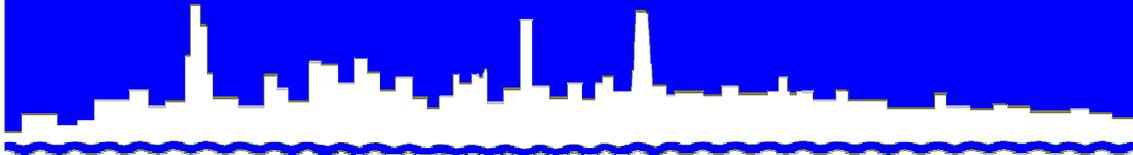

Metropolitan Water Reclamation District of Greater Chicago

***MONITORING AND RESEARCH
DEPARTMENT***

REPORT NO. 11-05

MONTHLY CONTROLLED SOLIDS

DISTRIBUTION REPORT

DECEMBER 2010

FEBRUARY 2011

Terrence J. O'Brien
President
Barbara J. McGowan
Vice President
Cynthia M. Santos
Chairman of Finance
Michael A. Alvarez
Frank Avila
Patricia Horton
Kathleen Therese Meany
Debra Shore
Mariyana T. Spyropoulos

Metropolitan Water Reclamation District of Greater Chicago

100 East Erie Street Chicago, Illinois 60611-3154 f: 312.751.5194 312.751.5190

Thomas C. Granato, Ph.D.
Acting Director of Monitoring and Research
thomas.granato@mwr.org

February 17, 2011

Mr. S. Alan Keller, P.E.
Manager, Permit Section
Illinois Environmental
Protection Agency
1021 North Grand Avenue East
P.O. Box 19276
Springfield, IL 62794-9276

Dear Mr. Keller:

Subject: Metropolitan Water Reclamation District of Greater Chicago – Controlled Solids Distribution Program Illinois Environmental Protection Agency Permit No. 2010-SC-0200, December 2010

This letter transmits information and data for the Metropolitan Water Reclamation District of Greater Chicago - Controlled Solids Distribution Program for December 2010, as required by Illinois Environmental Protection Agency Permit No. 2010-SC-0200.

Sludge flow schematic diagrams for solids processed during December 2010 are shown in Figure 1 - John E. Egan Water Reclamation Plant (WRP), Figure 2 - Calumet WRP, and Figure 3 - Stickney WRP.

Biosolids were not distributed under the Controlled Solids Distribution Program to any site in December.


Very truly yours,

Thomas C. Granato
Acting Director
Monitoring and Research

TCG:OO:cm
Attachments
cc: Aistars (USEPA)
Sulski (IEPA)
Kits
O'Connor

J.E. EGAN WRP SOLIDS DISTRIBUTION- FIGURE 1


December-10

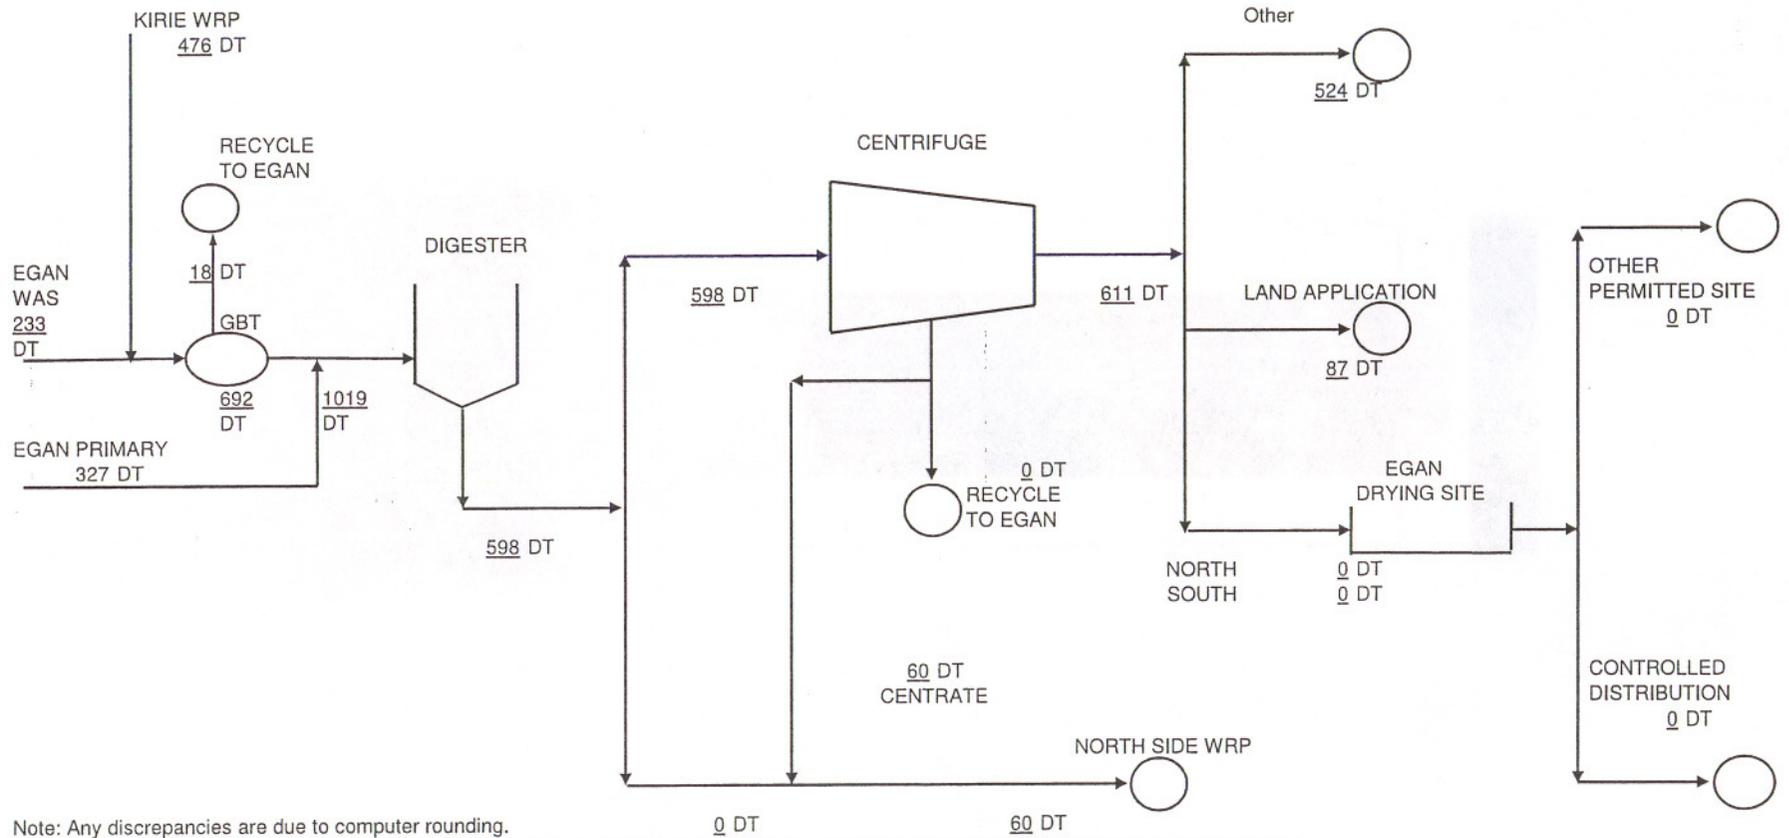

Note: Any discrepancies are due to computer rounding.
Centrifuge draw DT exceeds Centrifuge feed DT by 13 DT because of sample anomalies. Centrate DT are estimated to be approximately 60 DT.

CALUMET WRP SOLIDS DISTRIBUTION - December 2010

Figure 2

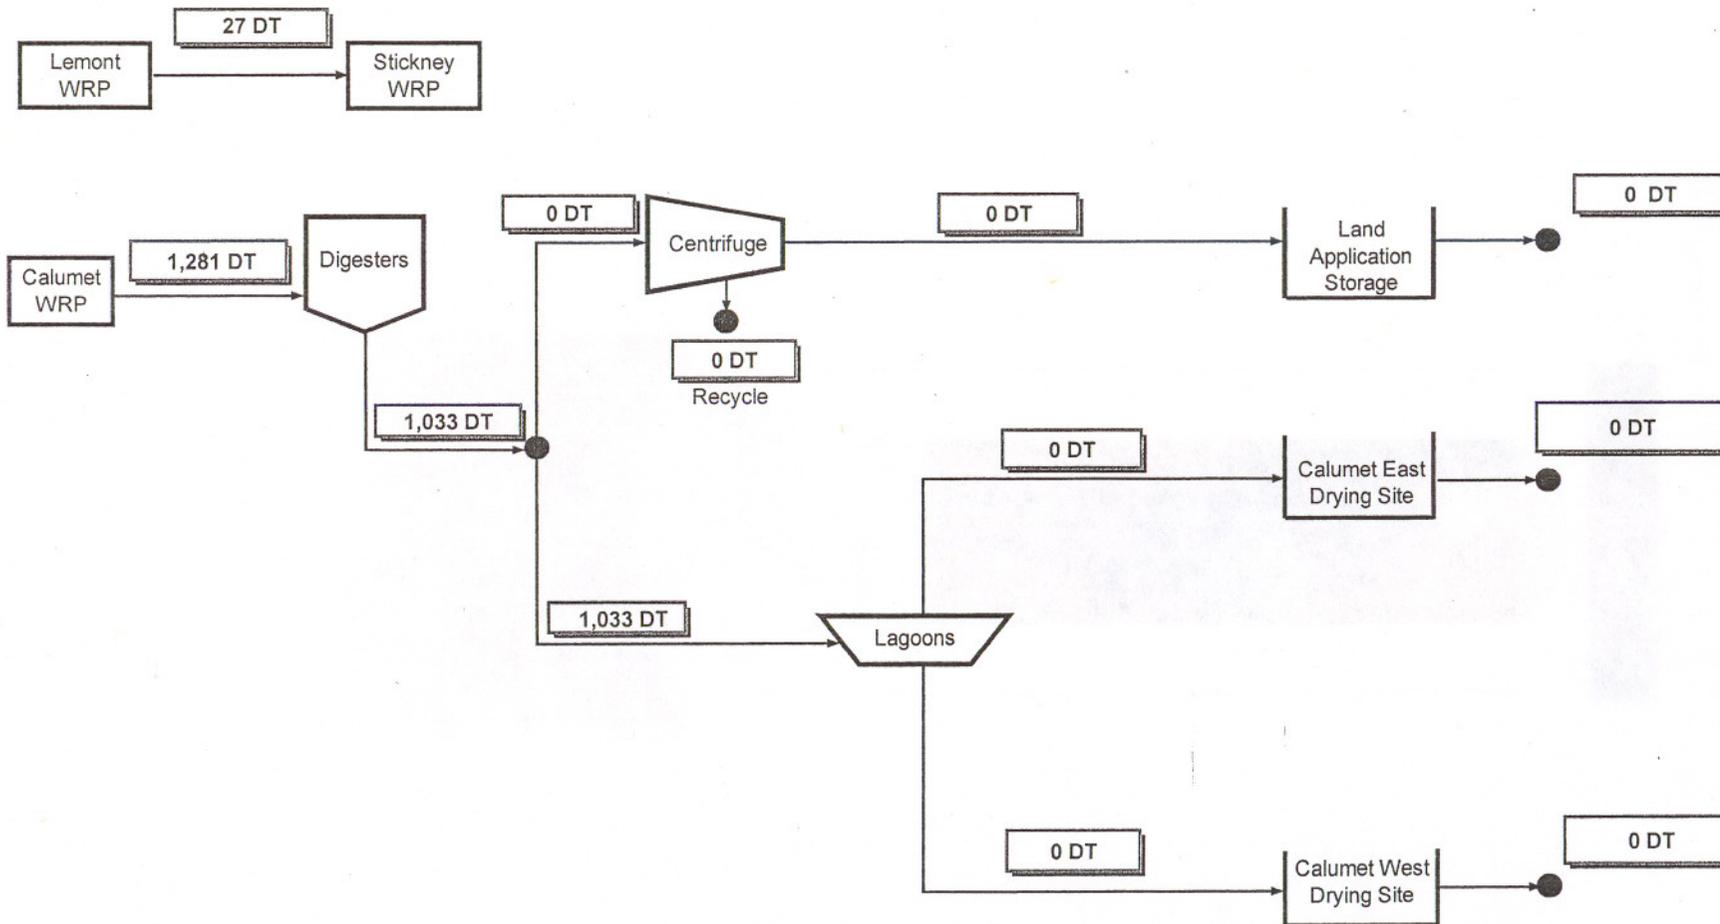

STICKNEY WATER RECLAMATION PLANT SOLIDS DISTRIBUTION FOR DECEMBER 2010

FIGURE 3

