


Protecting Our Water Environment

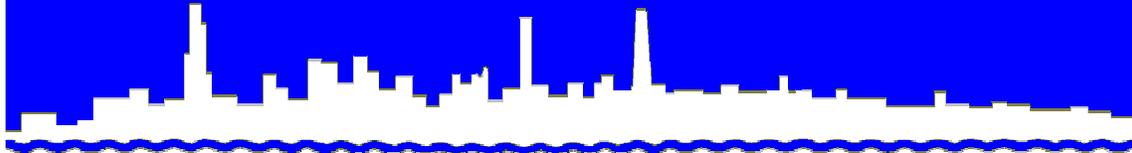

Metropolitan Water Reclamation District of Greater Chicago

***MONITORING AND RESEARCH
DEPARTMENT***

REPORT NO. 12-16

CONTROLLED SOLIDS DISTRIBUTION REPORT

FOR FIRST QUARTER 2012

MAY 2012

Protecting Our Water Environment

Board of Commissioners

Terrence J. O'Brien
President
Kathleen Therese Meany
Vice President
Gloria Alitto Majewski
Chairman of Finance
Frank Avila
Patricia Horton
Barbara J. McGowan
Cynthia M. Santos
Debra Shore
Mariyana T. Spyropoulos

Metropolitan Water Reclamation District of Greater Chicago

100 East Erie Street

Chicago, Illinois 60611-3154

312.751.5190

Thomas C. Granato, Ph.D.

Director of Monitoring and Research Department
thomas.granato@mwrld.org

May 23, 2012

Mr. S. Alan Keller, P.E.
Manager, Permit Section
Illinois Environmental
Protection Agency
1021 North Grand Avenue East
P.O. Box 19276
Springfield, IL 62794-9276

Dear Mr. Keller:

Subject: Metropolitan Water Reclamation District of Greater Chicago – Controlled Solids
Distribution Program Illinois Environmental Protection Agency Permit No. 2010-
SC-0200, First Quarter (January – March 2012)

This letter transmits information and data for the Metropolitan Water Reclamation District of Greater Chicago - Controlled Solids Distribution Program for the first quarter (January – March 2012) as required by Illinois Environmental Protection Agency Permit No. 2010-SC-0200 and 2010-SC-0200-2.

Sludge flow schematic diagrams for solids processed during January – March 2012 are shown in Figure 1 - John E. Egan Water Reclamation Plant (WRP), Figure 2 - Calumet WRP, and Figure 3 - Stickney WRP.

Biosolids were not distributed under the Controlled Solids Distribution Program to any site during the first quarter of 2012.

Very truly yours,

Thomas C. Granato, Ph.D.
Director
Monitoring and Research

TCG:AC:cm

Attachments


cc: V. Aistars (USEPA)

R. Sulski (IEPA)

C. O'Connor

J.E. EGAN WRP SOLIDS DISTRIBUTION- FIGURE 1


January - March 2012

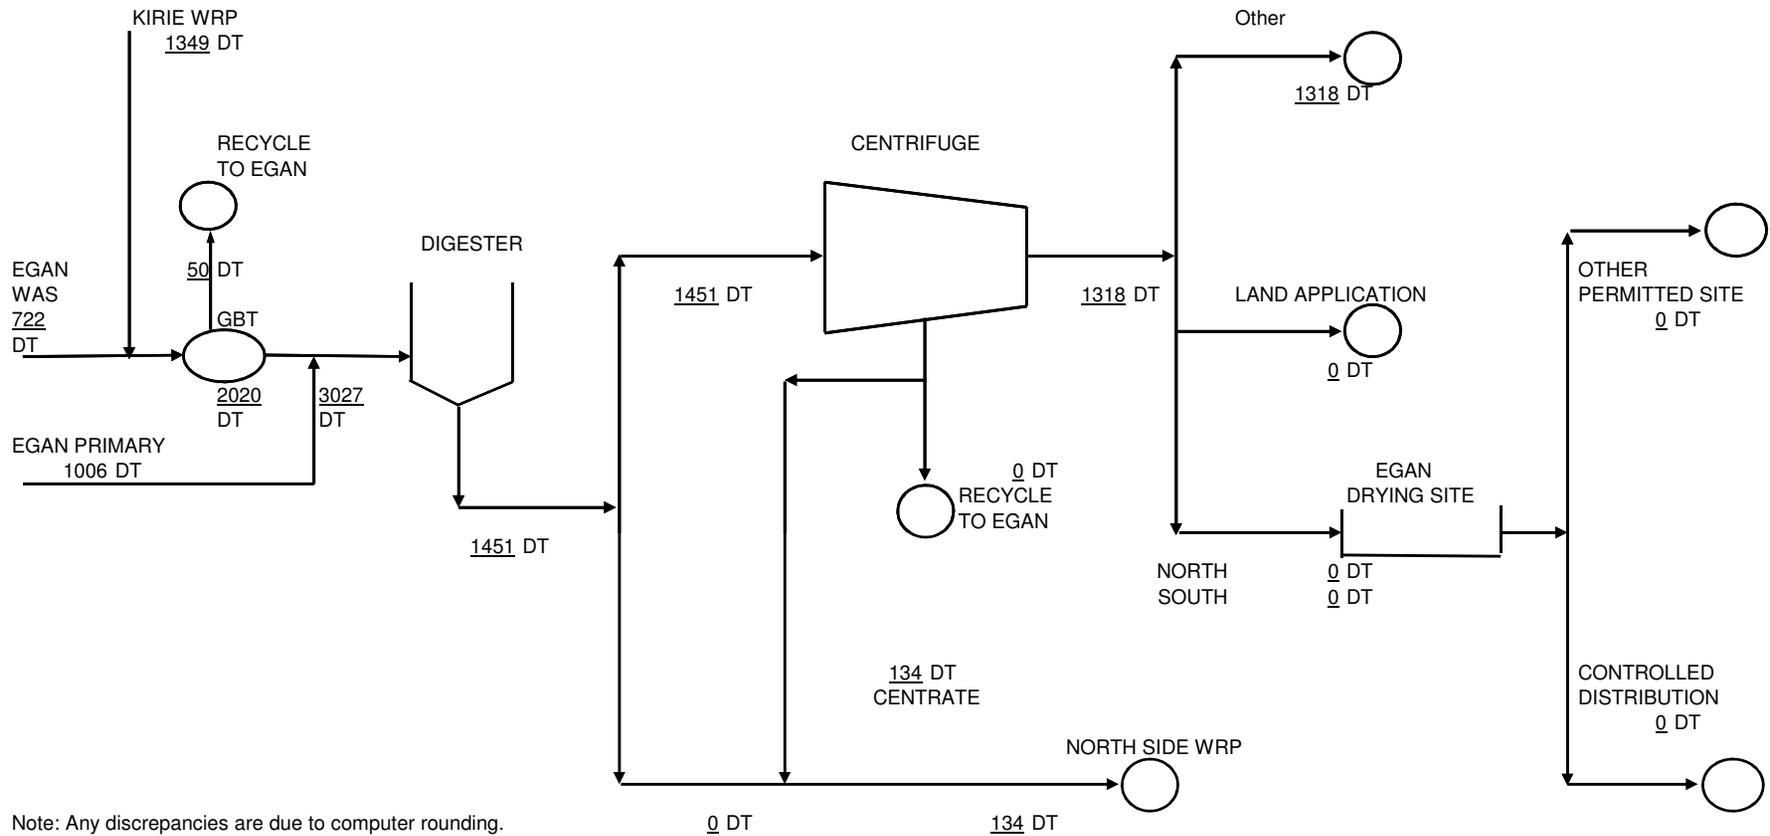

Note: Any discrepancies are due to computer rounding.


CALUMET WRP SOLIDS DISTRIBUTION - First Quarter 2012

Figure 2

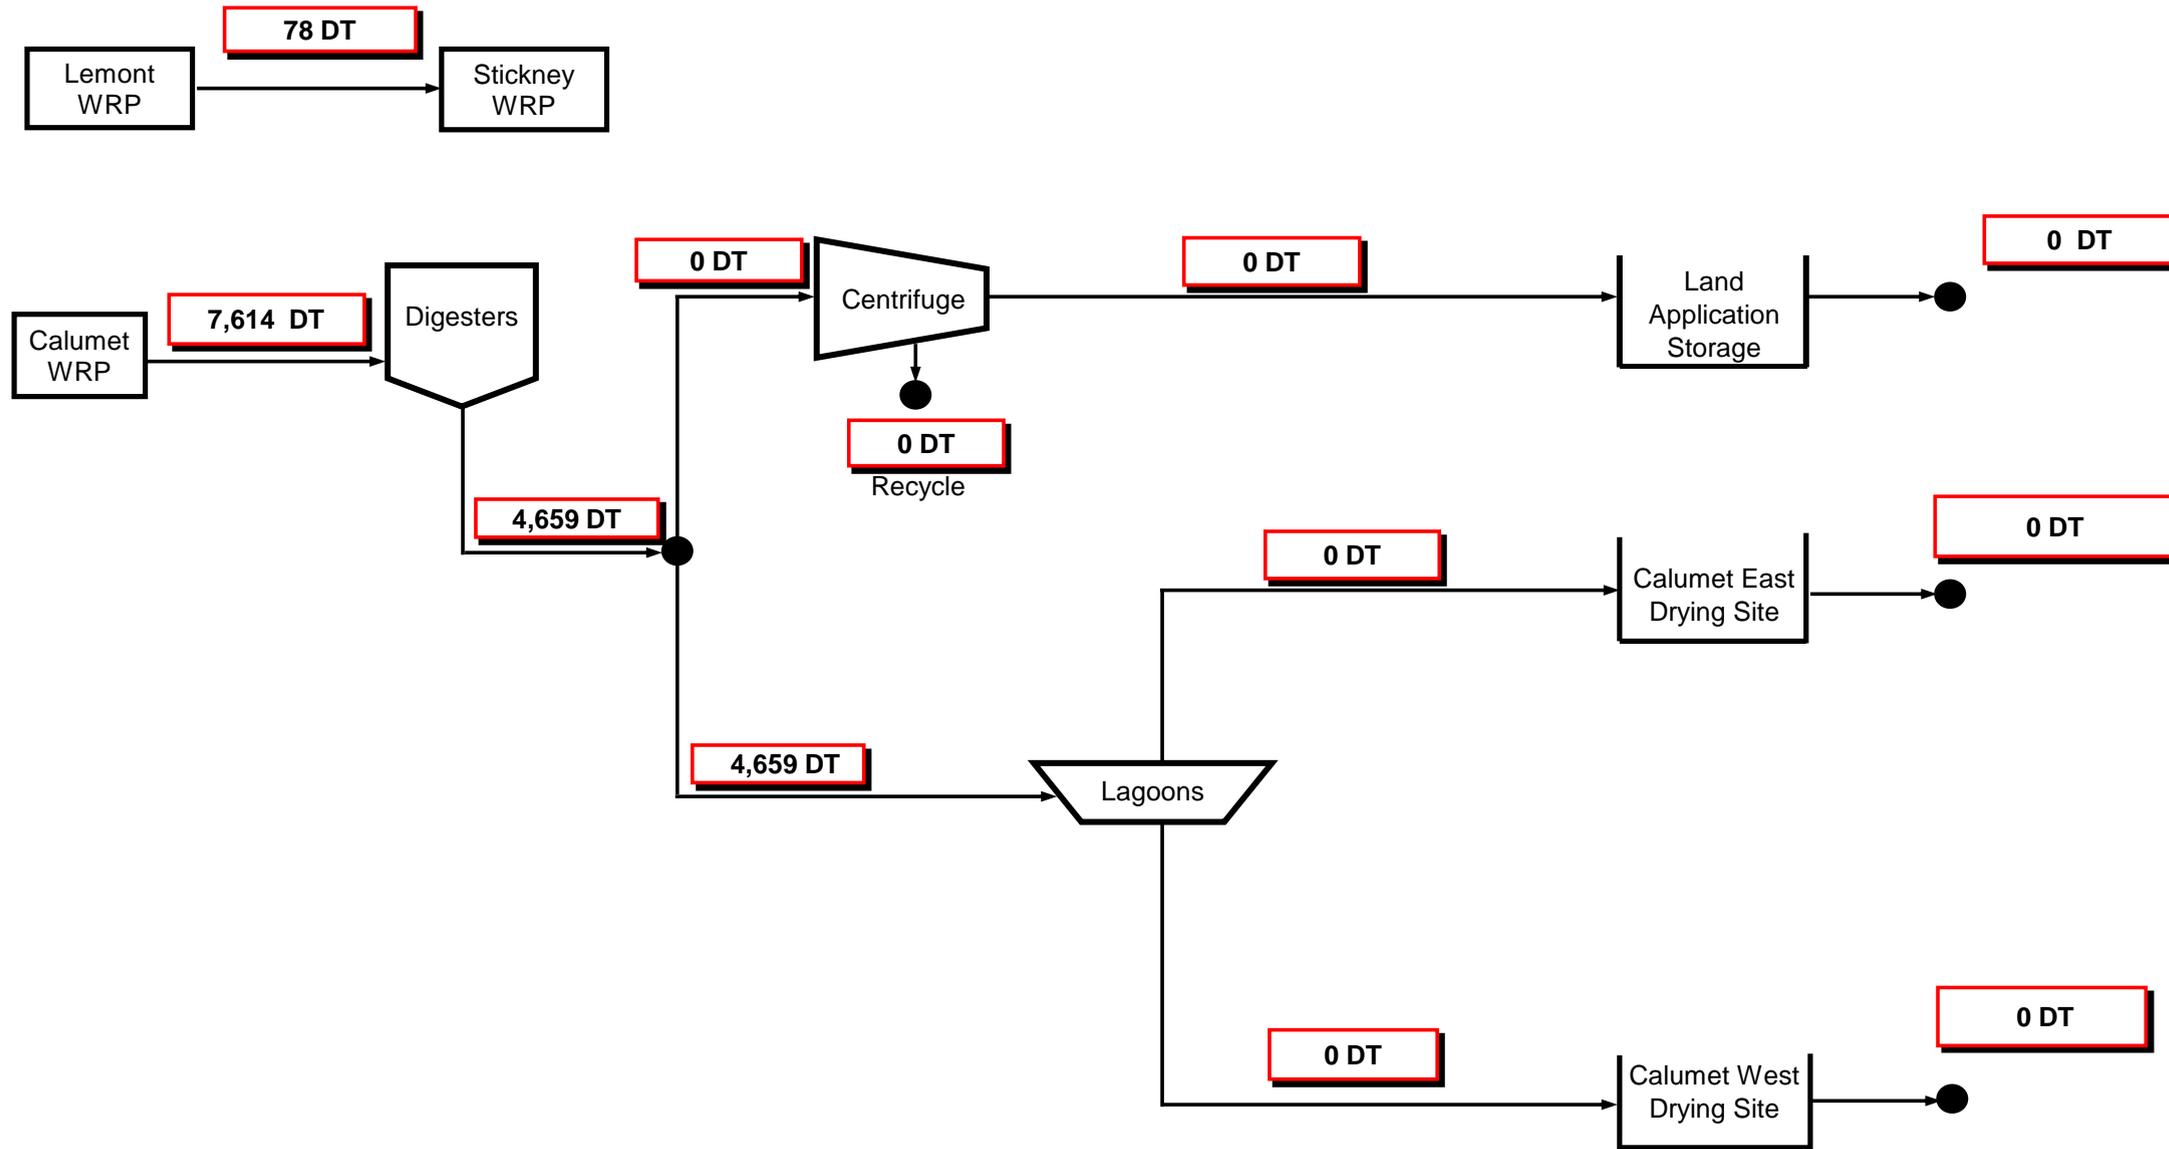

STICKNEY WATER RECLAMATION PLANT SOLIDS DISTRIBUTION FOR 1st QUARTER 2012

FIGURE 3

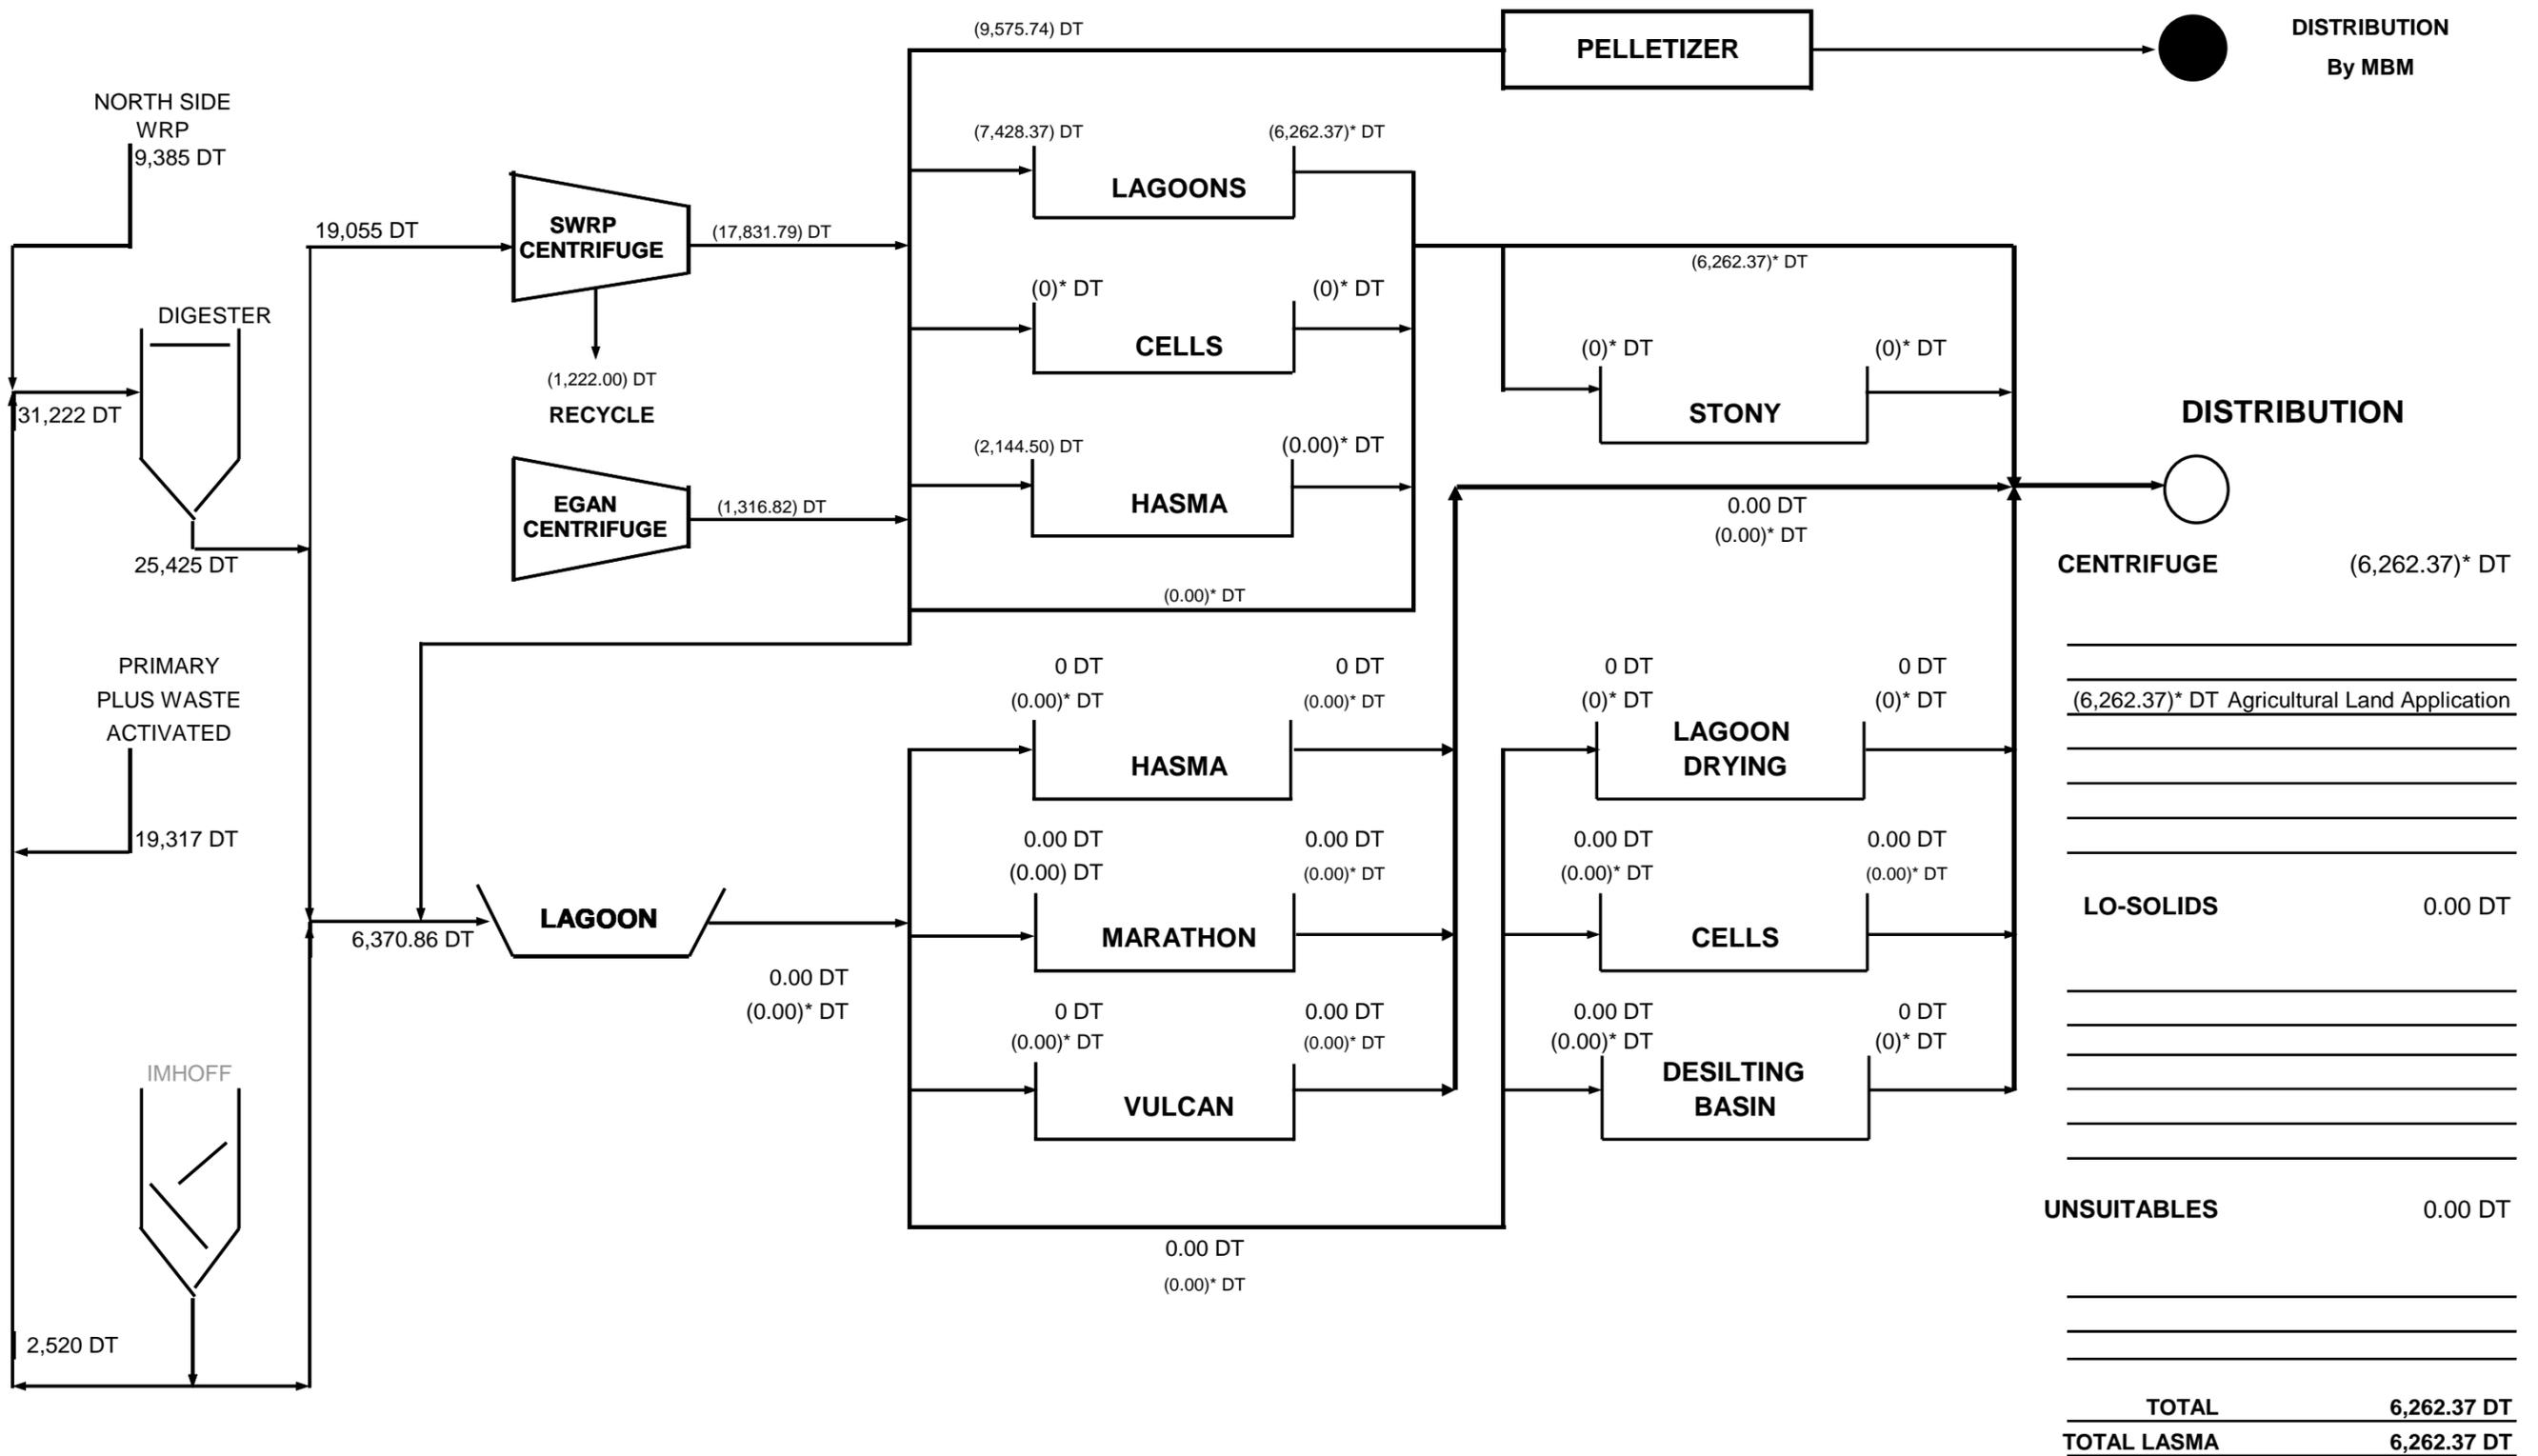

(CENTRIFUGE CAKE)*