


PLAN VIEW

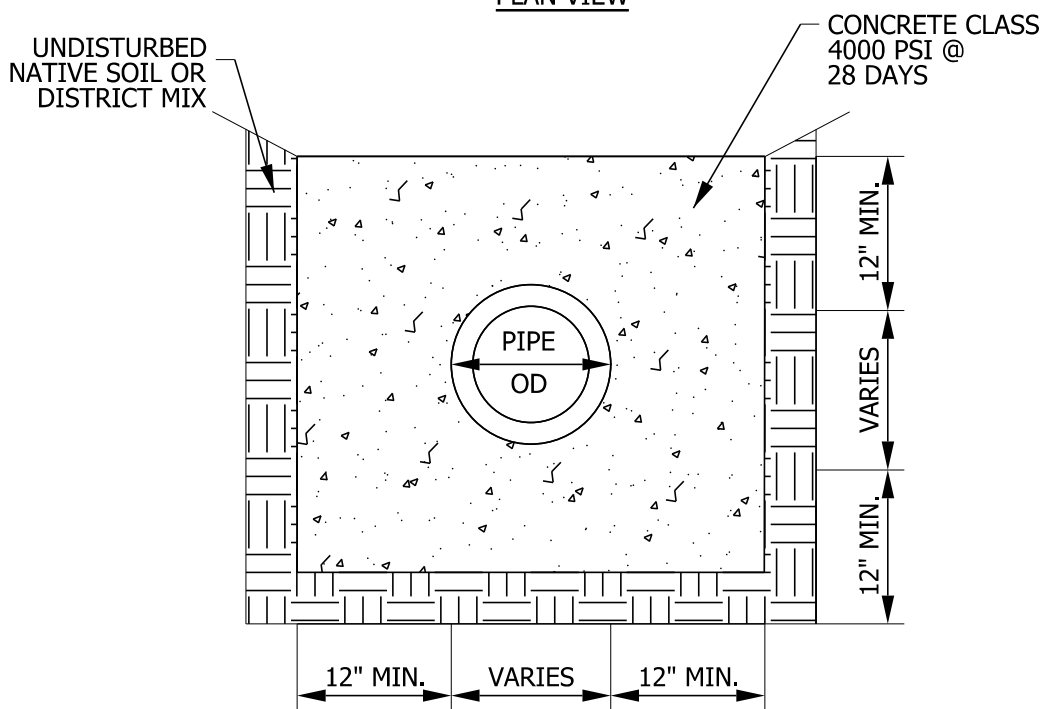

SECTION A - A

NOTES:

1. CONCRETE ENCASMENT SHALL BE PROVIDED WHERE SEPARATION REQUIREMENTS CANNOT BE MET.
2. ENCASMENT PLACED AGAINST UNDISTURBED NATIVE SOIL, OR FILL COMPACTED TO 90% RELATIVE COMPACTION.
3. NOT FOR PIPE TO PIPE CONNECTIONS.

NOT TO SCALE



TECHNICAL GUIDANCE MANUAL

7/1/15

CONCRETE ENCASMENT DETAIL

STD. DWG. NO. 31

PAGE NO. 32